


EXAMPLE

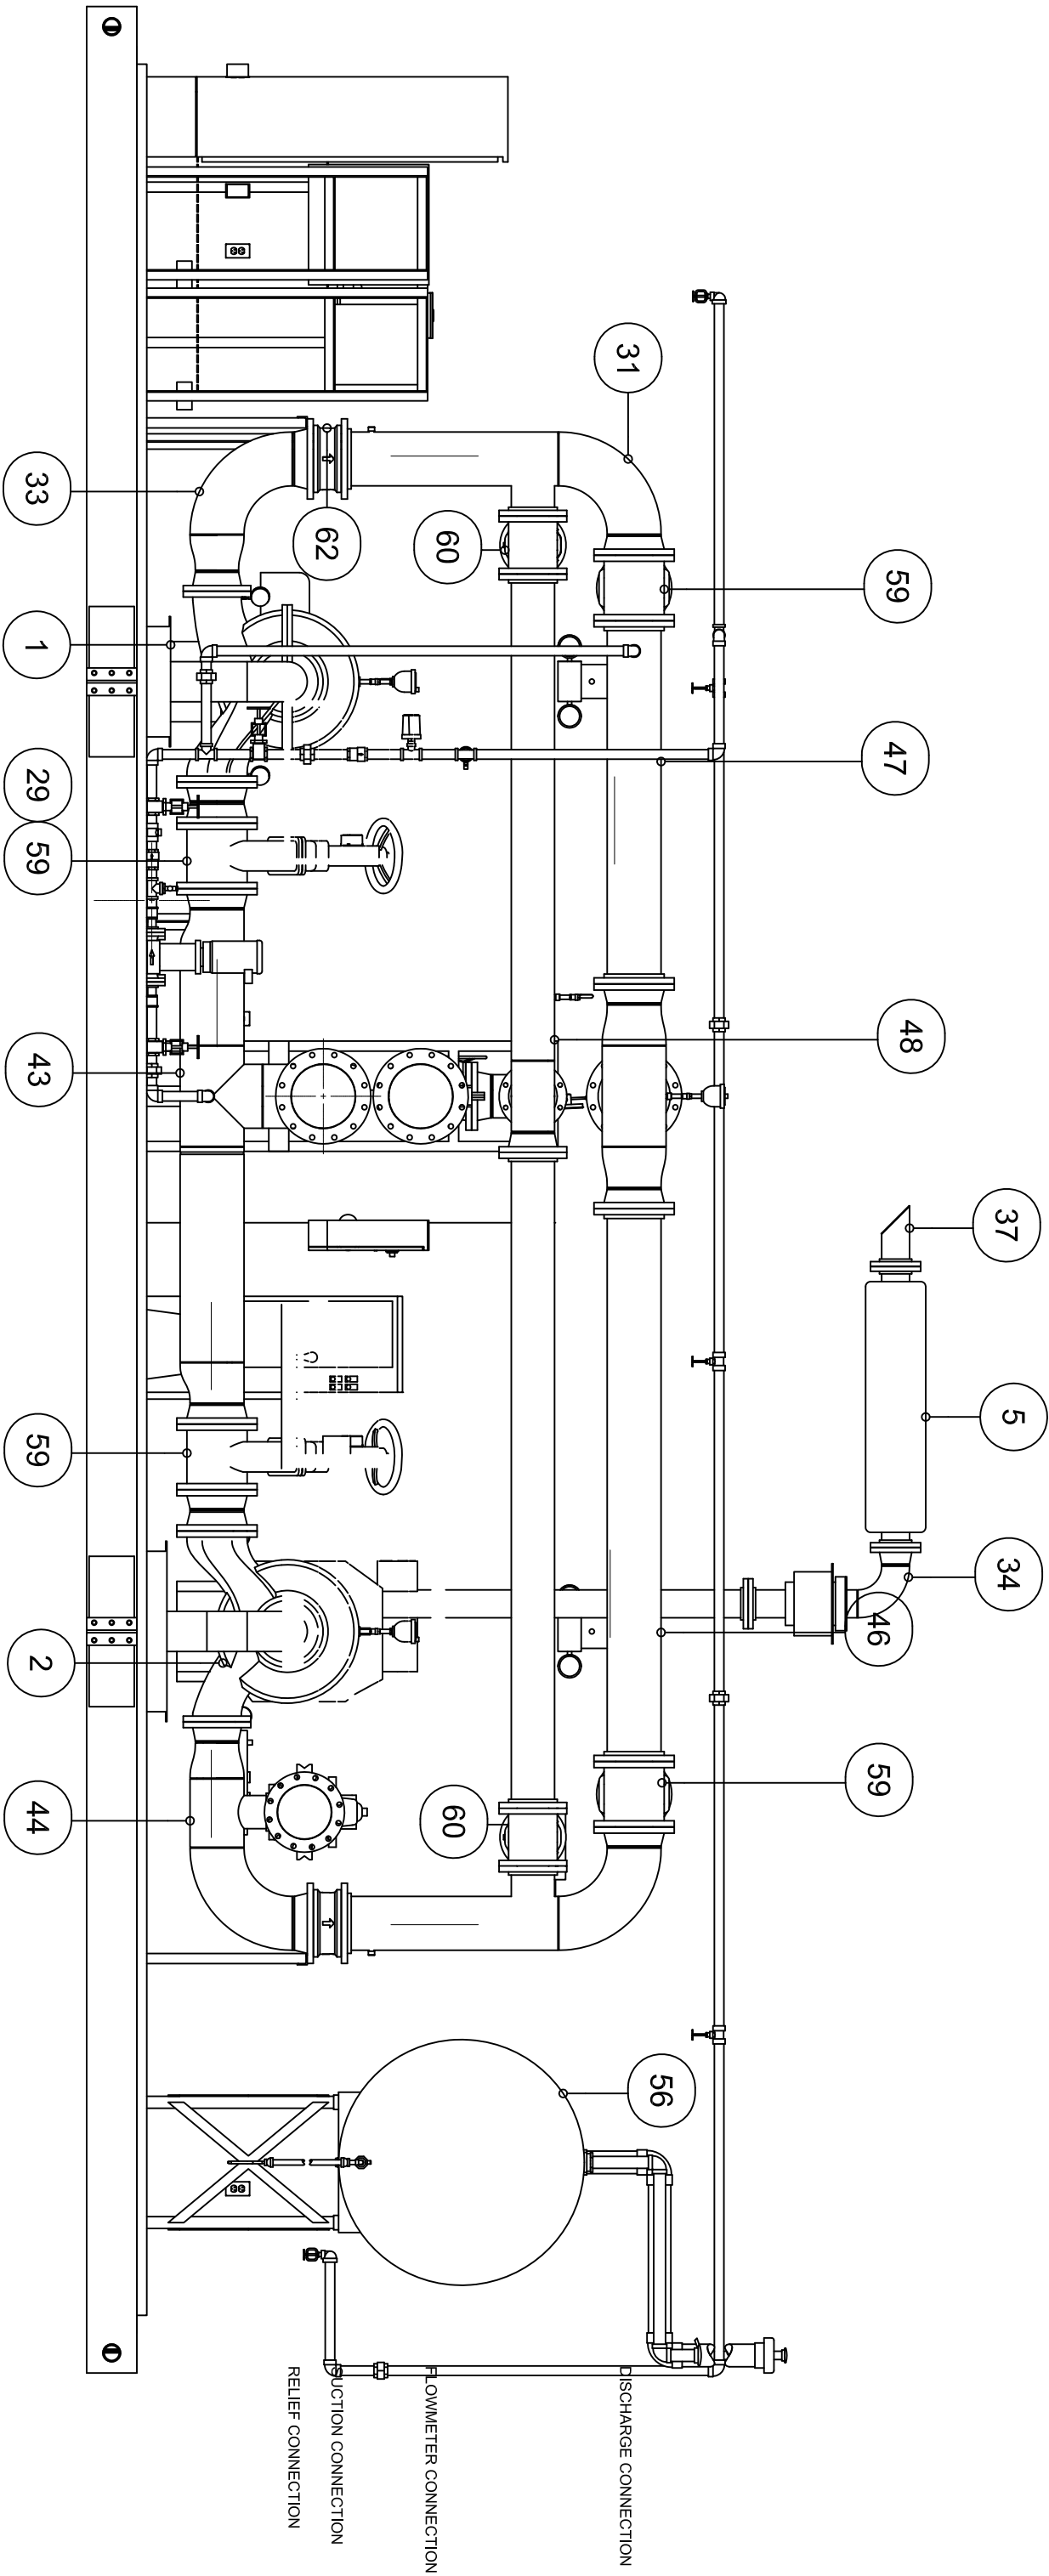

NOTES:

CONT.

1. FINISH: (SKID & PIPING) **RED ENAMEL PAINT.**

2. CONDITION POINT: **2500/2500 GPM @ 100 PSI**

SUCTION PRESSURE: **FROM PLANT WATER.**

200# MAXIMUM WORKING SYSTEM PRESSURE

3. ALL DIMENSIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE: DO NOT USE FOR CONSTRUCTION PURPOSES UNLESS CERTIFIED.

4. (XX) INDICATE REFERENCE DIMENSIONS.
5. PIPE SUPPORTS NOT SHOWN FOR CLARITY.

6. ALL WELDING DONE BY ASME CODE SECTION 9 CERTIFIED WELDERS.

7. FILL BASE WITH NON-SHRINKING, NON-FERROUS GROUT: FAILURE TO DO VOIDS TIGERFLOW WARRANTY.

8. **GLAND POCKET AND ENGINE COOLANT PIPED TO DRAIN.**

9. **2 HOUR FIRE WALL.**

10. **SEISMIC CALCULATIONS, (ZONE 4) STRUCTURAL CALCULATIONS WITH TEXAS P.E. STAMP.**

11. **TEXAS P.E. STAMP ON ENCLOSURE.**