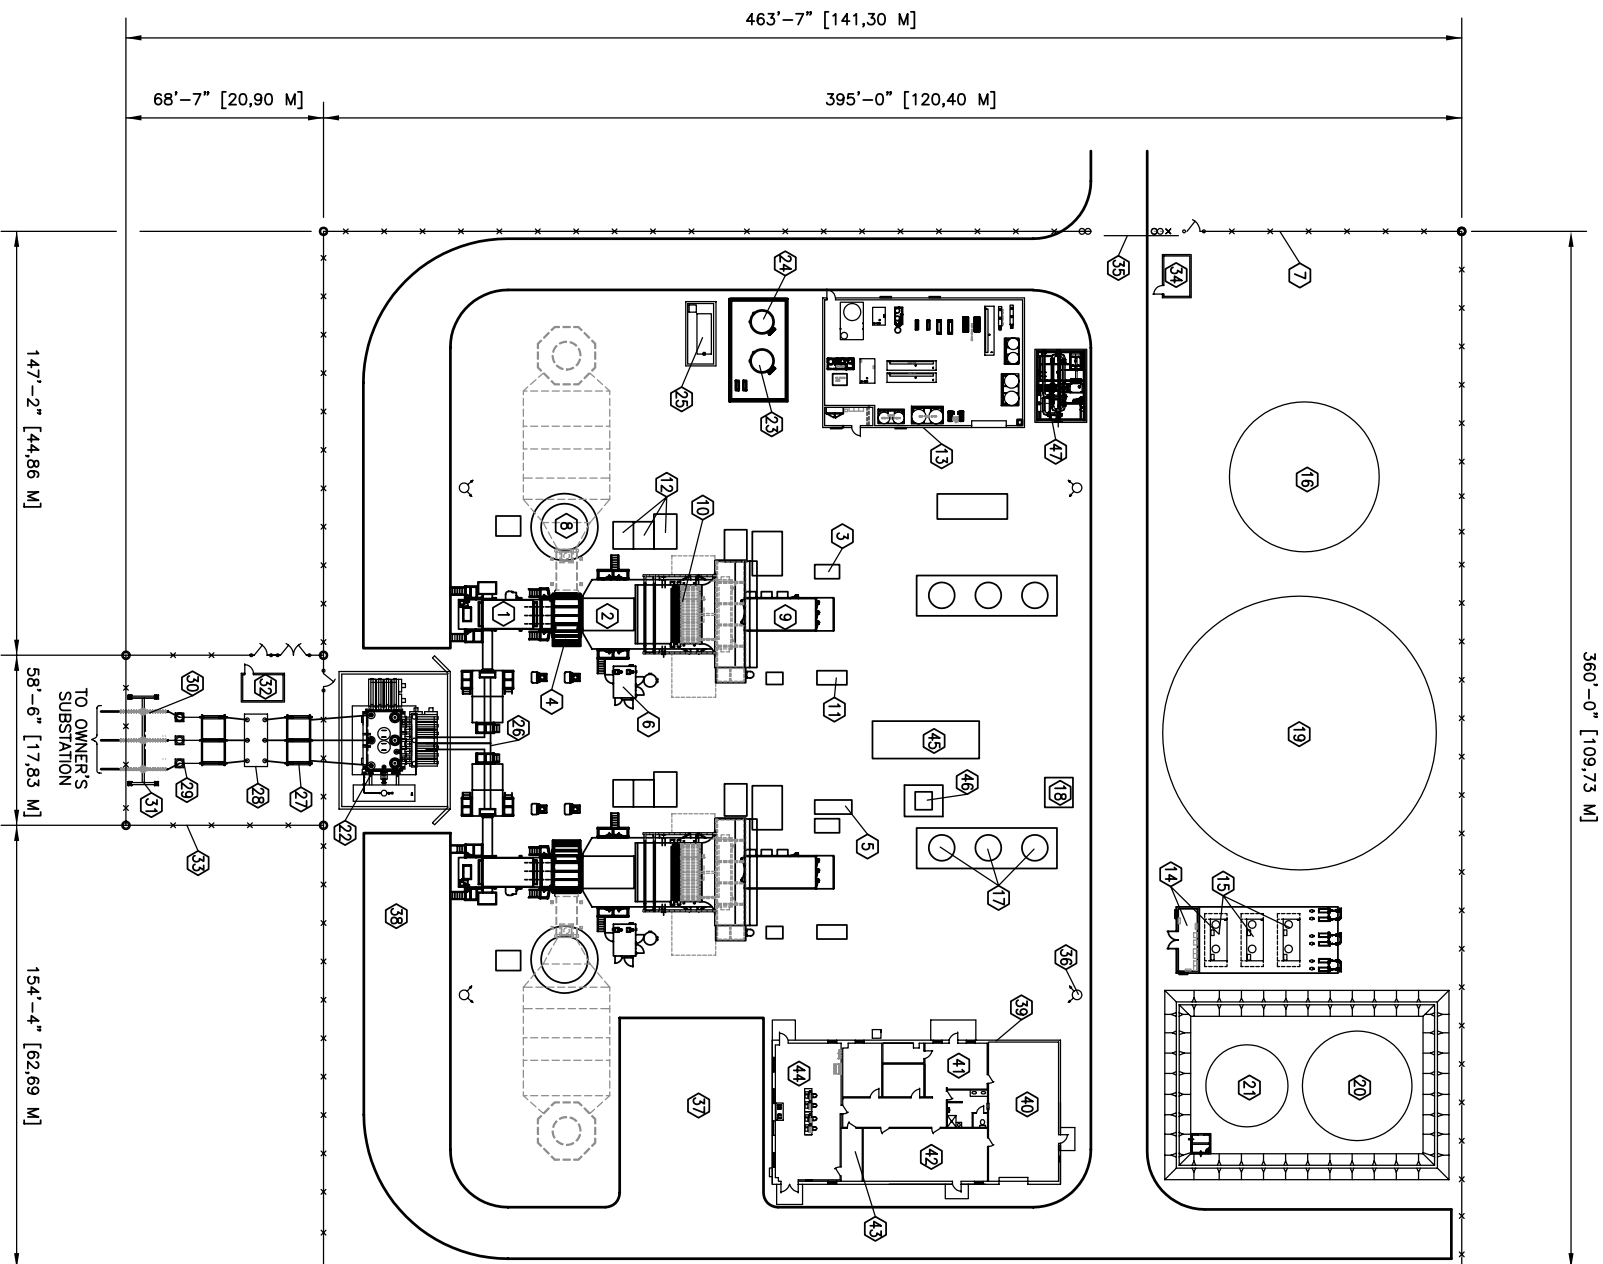


LEGEND:

- ① GE FRAME 7EA GAS TURBINE.
- ② ACCESSORY MODULE.
- ③ AIR PROCESSING UNIT.
- ④ EXHAUST FRAME BLOWERS.
- ⑤ CO2 FIRE PROTECT SYSTEM.
- ⑥ GAS FUEL MODULE.
- ⑦ PLANT FENCE.
- ⑧ EXHAUST STACK.
- ⑨ PECC AREA.
- ⑩ TURBINE INLET FILTER HOUSE.
- ⑪ FUEL GAS ELECTRIC HEATER MODULE.
- ⑫ FUEL GAS SCRUBBERS.
- ⑬ WATER TREATMENT BUILDING.
- ⑭ DIESEL FUEL TREATMENT SHED.
- ⑮ CENTRIFUGAL AND FORWARDING PUMPS.
- ⑯ DEMIN STORAGE TANK (500,000 GALS.).
- ⑰ COOLING WATER MODULE.
- ⑱ COOLING WATER SUMP.
- ⑲ FIRE/RAW WATER TANK (2,000,000 GALS.).
- ⑳ CLEAN FUEL DRY TANK (200,000 GALS.).
- ㉑ RAW FUEL TANK (100,000 GALS.).
- ㉒ GSU TRANSFORMER.
- ㉓ WASTE OIL TANK.
- ㉔ WASTE WATER TANK.
- ㉕ OILY WATER SEPARATOR.
- ㉖ OVERHEAD CABLE TRAY.
- ㉗ DISCONNECT SWITCH.
- ㉘ SFB BREAKER.
- ㉙ VOLTAGE TRANSFORMER (TYPE CVT).
- ㉚ LIGHTNING ARRESTER.
- ㉛ DEAD END TOWER.
- ㉜ SUBSTATION HOUSE.
- ㉝ SUBSTATION FENCE.
- ㉞ GUARD HOUSE.
- ㉟ GATE.
- ㊱ LIGHTING POLE.
- ㊲ PARKING AREA.
- ㊳ ROAD.
- ㊴ CONTROL/UTILITY BUILDING.
- ㊵ WAREHOUSE.
- ㊶ OFFICE ROOMS.
- ㊷ CONFERENCE ROOM.
- ㊸ STORAGE ROOM.
- ㊹ CONTROL ROOM.
- ㊺ ELECTRICAL ROOM.
- ㊻ AUXILIARY TRANSFORMER (480 V).
- ㊼ FIRE WATER SCD.

[illegible]