



- NOTES:
1. THIS DRAWING DESCRIBES THE PROVISIONS MADE FOR TAKING TEST MEASUREMENTS. THESE PROVISIONS CONSIST GENERALLY OF EXTERNALLY ACCESSIBLE HOLES FOR THE INSERTION OF TEMPERATURE OR PRESSURE PROBES.
 2. NO RECORDING DEVICES ARE INCLUDED. NO SENSORS ARE PROVIDED EXCEPT IN THOSE CASES WHERE A PROBE CANNOT BE INSERTED FROM THE OUTER CASING. IN SUCH CASES AN EXTERNALLY ACCESSIBLE CONNECTION POINT IS PROVIDED.
 3. INSTRUMENTATION EXTERNAL TO THE GAS TURBINE UNIT IS NOT INCLUDED.
 4. LOCATION OF TEST EXHAUST THERMOCOUPLES TO BE ON FACTORY TEST DUCT WORK.
 5. FOR ARRANGEMENT OF CONDUIT FOR EXHAUST & TURBINE, SEE UNIT ML ITEM 1106 & 1103 RESPECTIVELY.

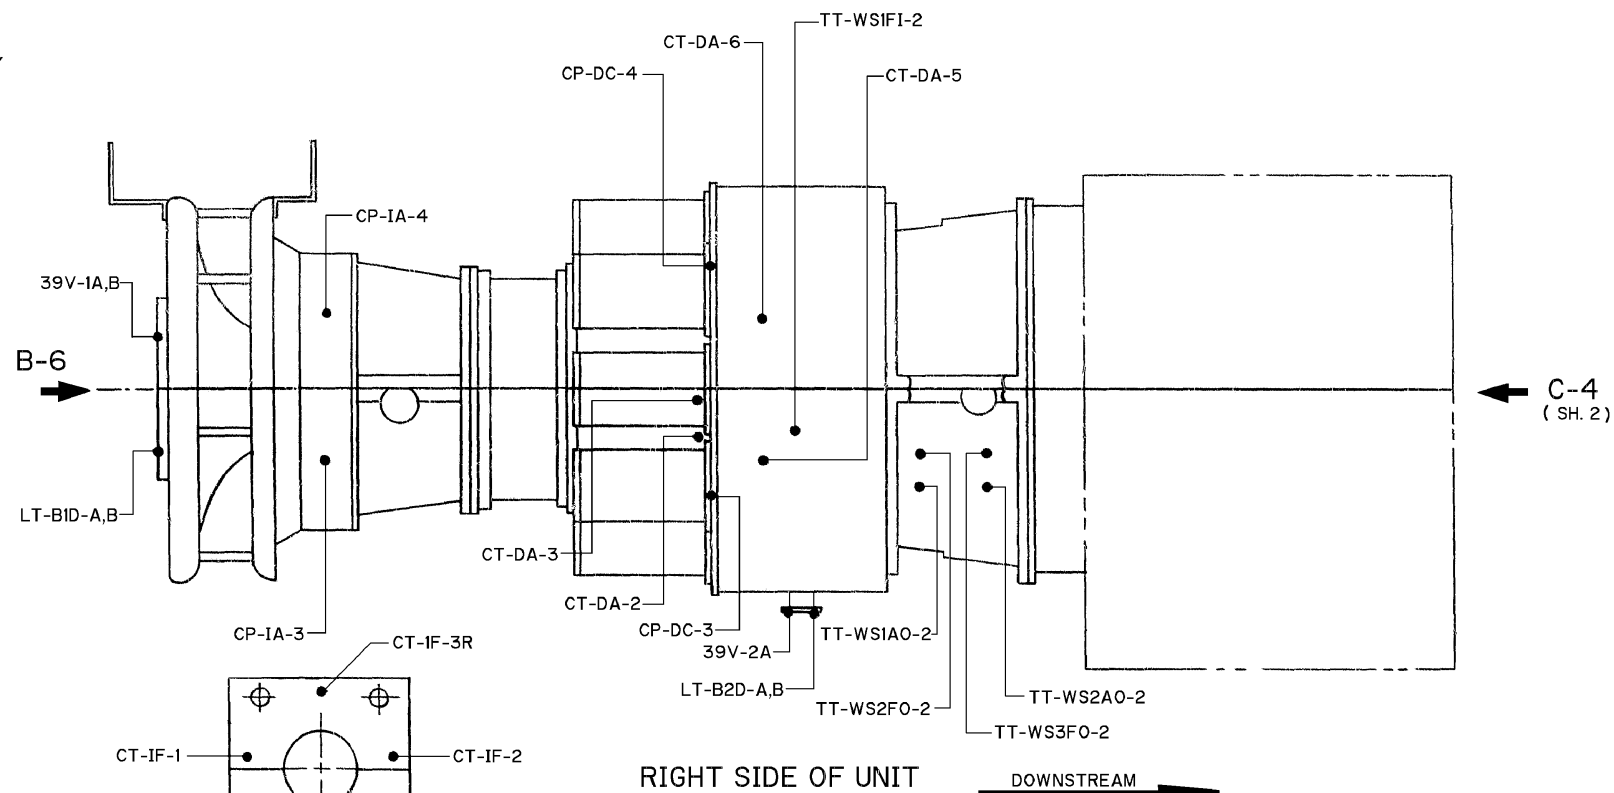

VIEW B-6 (C-7)
(FWD WALL OF INLET PLENUM)

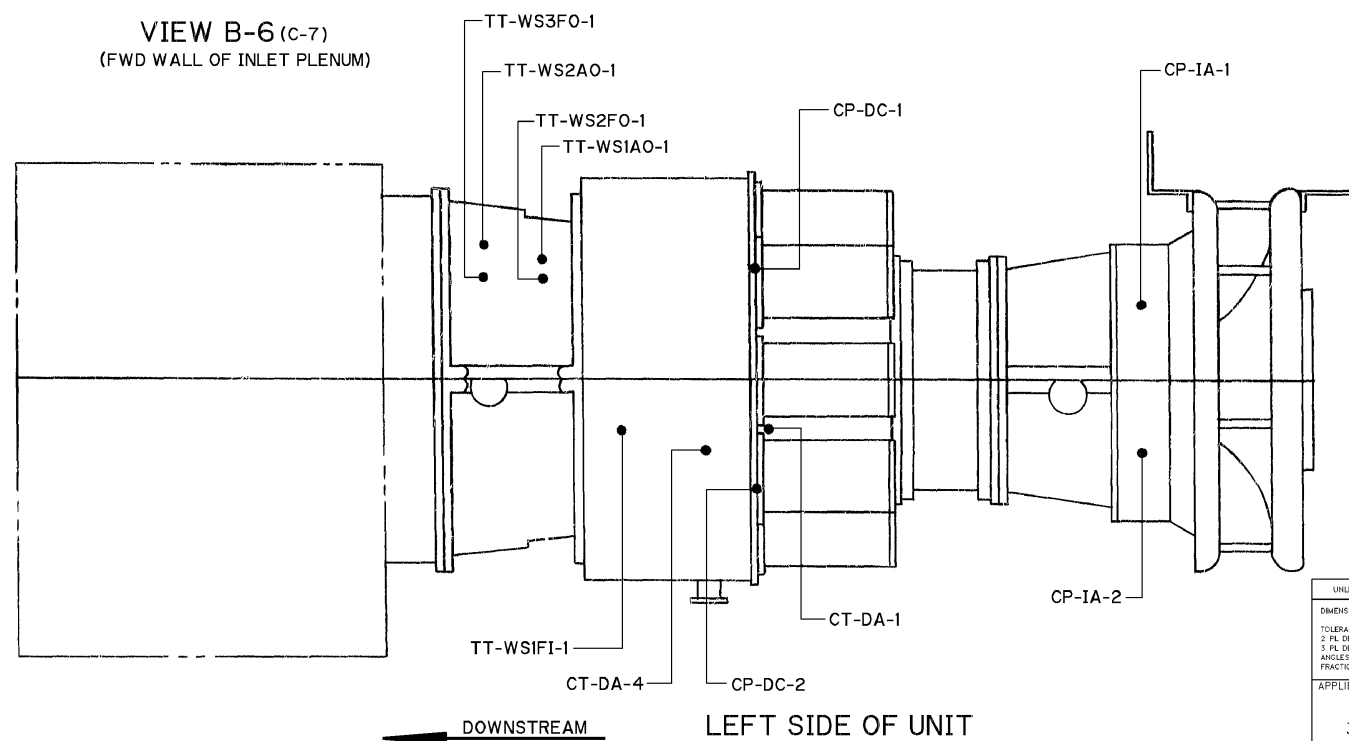

| REV | DESCRIPTION | DATE | APPROVED |
|-----|-------------|------|----------|
| 1 | 193D2088 | 1 | - |

THIS DRAWING TO BE REVISED ON FORMTEK ONLY.


| 1 | APPLIED PRACTICE, GENERAL | 348A9200 |
|------|---------------------------|------------|
| ITEM | TITLE | IDENT. NO. |

© COPYRIGHT 1995 GENERAL ELECTRIC COMPANY
PROPRIETARY INFORMATION—THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION OF GENERAL ELECTRIC COMPANY AND MAY NOT BE USED OR DISCLOSED TO OTHERS, EXCEPT WITH THE WRITTEN PERMISSION OF GENERAL ELECTRIC COMPANY.

| - | - | REV | REV STATUS |
|---|---|-----|------------|
| 2 | 1 | SH | OF SHEETS |

| UNLESS OTHERWISE SPECIFIED | SIGNATURES | DATE | GE Power Generation |
|----------------------------|------------------|----------|---|
| DRAWN: D.B.WILLIAMS | | 95-10-05 | GENERAL ELECTRIC COMPANY GAS TURBINE Greenville, SC |
| CHECKED: S.M.MCMAHON | | 95-10-05 | |
| ENGINEER: ANTHONY THERMOS | | 95-10-05 | |
| ISSUED: D.B.WILLIAMS | | 95-10-09 | |
| APPLIED PRACTICES | BY: LARRY LAVOIE | 95-10-06 | |
| 348A9200 | | | |
| SIMILAR TO: 188D7805 | | | |

| GE Power Generation | INSTRUMENTATION ARR, UNIT |
|------------------------------|---------------------------|
| FIRST MADE FOR ML-7A/PEA1-13 | O211 |
| SIZE: D | DWG. NO. 193D2088 |
| SCALE | WEIGHT |
| SHEET 1 | GE4D |



DT-1N 8

7

6

5

4

3

2


1

GE4D

△



THIS DRAWING TO BE REVISED ON FORMTEK ONLY.

| | | | | | | |
|--|--|-----------------|------------------|-----------|---------------------------------|-------------|
|  GE Power Generation | GENERAL ELECTRIC COMPANY 245 TURNER Greenville, SC | | SIZE D | CAGE CODE | DWG. NO. 193D2088 | DISTR TO |
| | DRAWN D.B.WILLIAMS | 95-10-05 | SCALE | | SHEET 2 | |
| ISSUED D.B.WILLIAMS | 95-10-09 | | | | | |